



An AVANGRID Company

# Derby Junction to Ansonia 115-kV Transmission Line Rebuild Project

## CONTACT

Project Information Line: **888.848.3697**


Website: [uinet.com/reliable service](http://uinet.com/reliable-service)

## PROJECT DESCRIPTION

Rebuild the existing transmission lines along the 4.1-mile corridor between Derby Junction in Shelton, spanning the Housatonic River, and crossing portions of Derby and Ansonia, ending at the existing Ansonia Substation. The transmission lines presently consist of 34 double circuit lattice-type structures and 7 monopole structures. UI proposes to replace these structures with a combination of double circuit and a few single circuit steel monopoles to improve the reliability of the electric transmission system for customers in Connecticut and New England.

## PROJECT NEED AND BENEFITS TO THE REGION

The existing transmission line structures were originally built in the early 1920s. Over the years, the transmission lines have been upgraded several times in response to increasing demand for electricity. Detailed engineering analyses and field inspections have determined that the lines now must be completely rebuilt to assure the continuation of reliable and resilient electric service to our community.

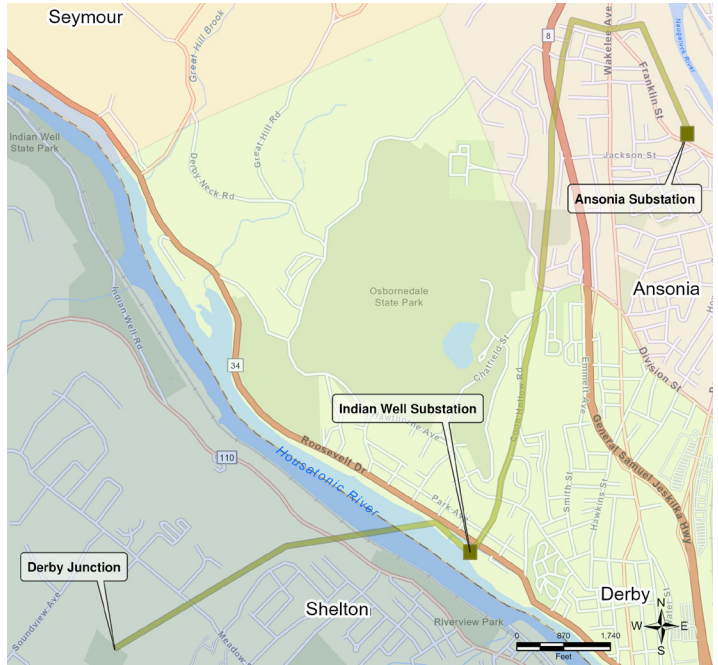

## PROJECT SCOPE

UI proposes to rebuild the transmission lines between Derby Junction and Ansonia Substation. These upgrades will require the following:

- Perform engineering and environmental surveys along the transmission corridor
- Prepare the corridor for construction (involving vegetation clearing and grading as necessary)
- Construct approximately 40 new steel monopoles, along with new conductors, insulators, and hardware
- Remove all existing transmission structures
- Restore (regrade, seed) the areas affected by construction

## PROJECT FACTS

Municipalities: Ansonia, Shelton and Derby

Counties Impacted: New Haven and Fairfield

## ESTIMATED TIMETABLE (subject to change)

Permitting Approvals: 1st Quarter 2023

Construction: 1st Quarter 2024

Completion/In-Service Date: 3rd Quarter 2025



*Typical existing lattice steel structure in Derby*